

LOCATION PER APPROVED PLAN

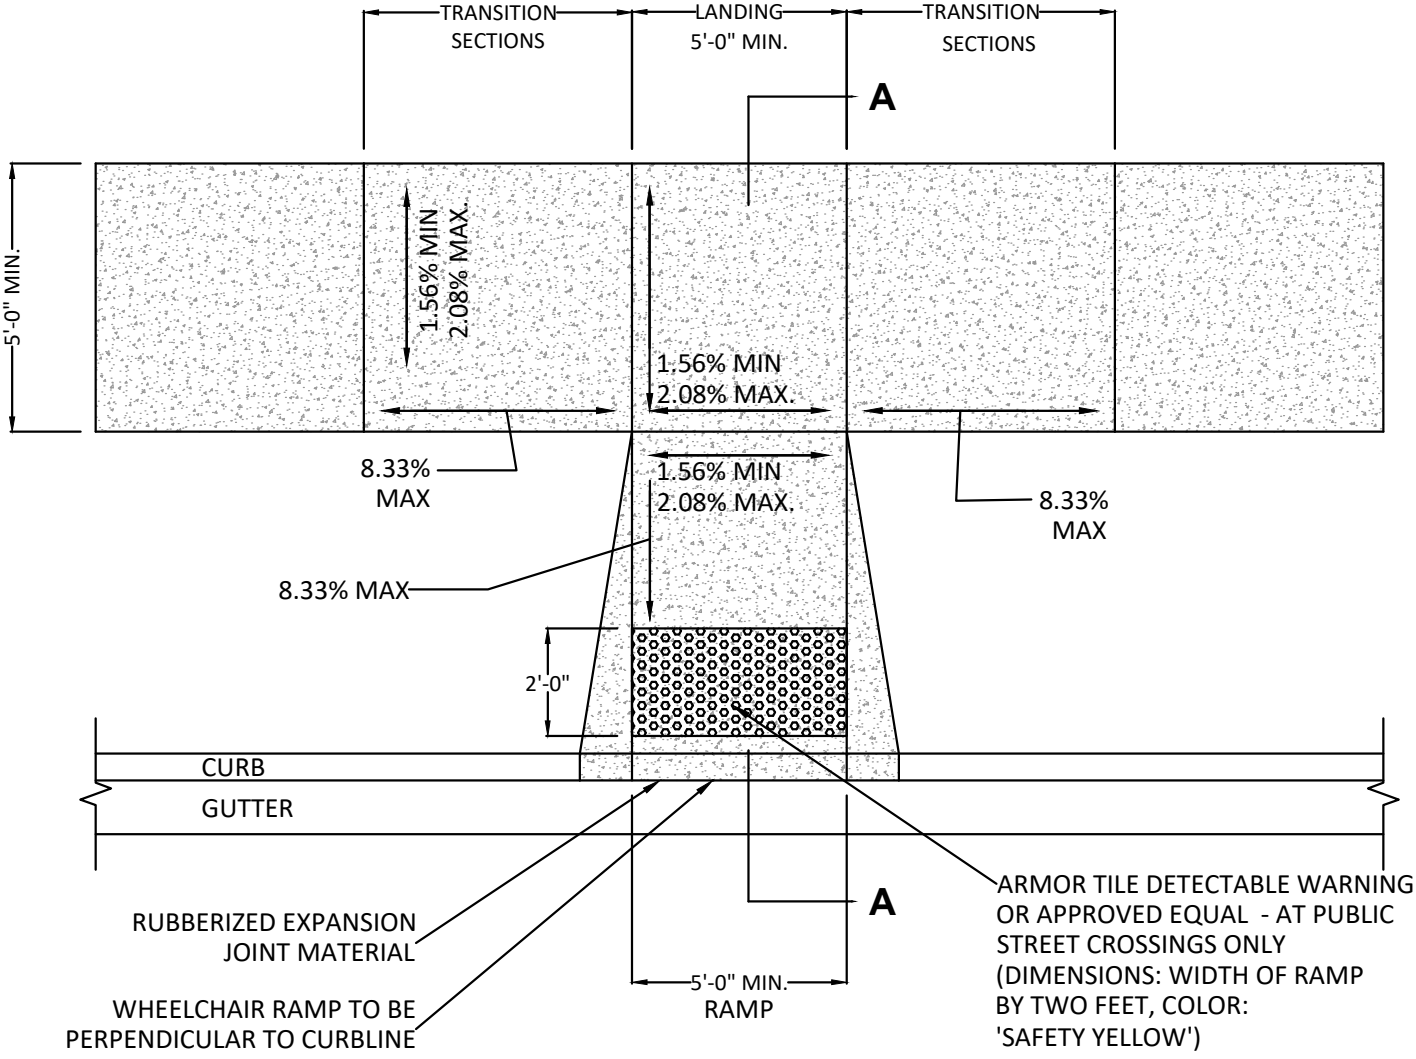

%	IN/FT	SLOPE
1.56	3/16"/FT	1:64
2.08	1/4"/FT	1:48
5.00	0.6"/FT	1:20
8.33	1"/FT	1:12

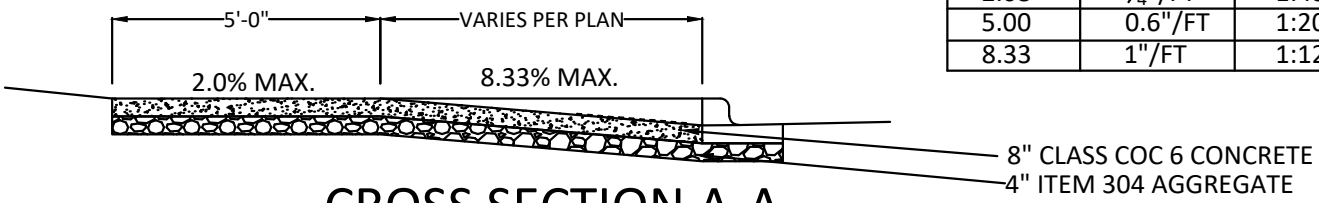

CROSS SECTION A-A

NOTES:

1. ALL JOINTS AT CURB RAMP LANDING SHALL BE SAW CUT.
2. RUBBERIZED EXPANSION JOINT MATERIAL SHALL BE 1/2-INCH REFLEX RUBBERIZED EXPANSION JOINT MATERIAL OR APPROVED EQUAL AND PLACED WHEREVER NEW CONCRETE WALK ABUTS THE BACK OF CURB, AND AT A MAXIMUM TRANSVERSE INTERVALS OF 30-FT. FOARMTECH CONCRETE EXPANSION JOINT FOAM OR AN APPROVED EQUIVALENT SHALL BE USED AROUND RADII.

EST 1808 CITY OF DELAWARE OHIO

Public Works Department

STANDARD DETAIL

ADA COMPLIANT CURB RAMP

ROADWAY

RDWD-19.4

9/19/2025