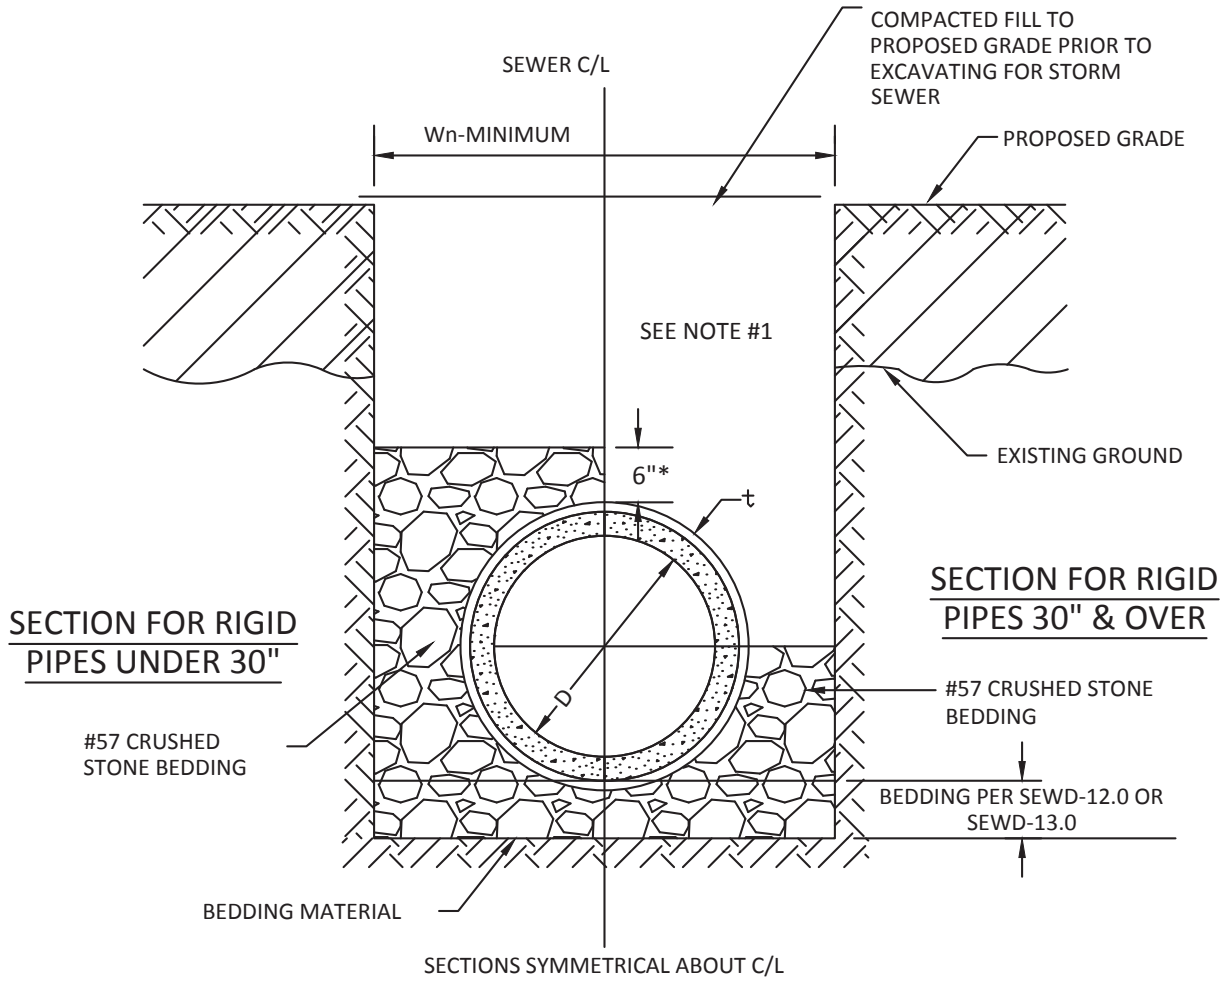


*12" FOR ALL FLEXIBLE PIPES REGARDLESS OF SIZE.

NOTES:

1. BACKFILL OF TRENCH FROM TOP OF #57 CRUSHED STONE BEDDING TO THE TOP OF TRENCH SHALL BE COMPACTED TO 98% MAXIMUM DRY DENSITY IN ACCORDANCE WITH SECTION 911. NO GRITS WILL BE ALLOWED.
2. THE COMPACTION REQUIREMENT WILL BE STRICTLY ENFORCED BY THE CITY.
3. THE C/L OF THE PROPOSED STORM SEWER SHOULD BE OFFSET FROM THE PROPERTY LINE.
4. THE COST OF THE #57 CRUSHED STONE BEDDING, COMPACTED FILL AND BACKFILL SHALL BE INCLUDED IN ITEM 901.
5. MINIMUM WIDTH OF TRENCH (Wn) ARE AS SHOWN ON DRAWINGS SEWD-12.0 OR SEWD-13.0.

EST 1808
CITY OF DELAWARE OHIO
Public Works Department

STANDARD DETAIL

TYPICAL TRENCH DETAIL

FOR STORM SEWERS OUSIDE R/W WITH COVER OF 30-INCHES OR LESS

UTILITIES

SEWD-14.0

Rev. 12/31/2018