
NOTES:

1. USE OF THIS DETAIL ONLY APPLIES TO PRIVATE WATER SYSTEMS NOT CONTAINING INDIVIDUAL METERS AT EACH SERVICE. FOR DOMESTIC WATER SERVICES ON PUBLIC WATER SYSTEMS, SEE WTRD-1.2.
2. THE CURB BOX SHALL BE PLACED 1'-0 FROM THE EDGE OF THE SIDEWALK OR 2'-0 INSIDE THE RIGHT-OF-WAY OR EASEMENT LINE WHEN NO SIDEWALK IS PRESENT OR PROPOSED.
3. THE CURB STOP SHALL BE INSTALLED WITH VALVE OPENING FACING THE STRUCTURE TO BE SERVED. THE CURB STOP SHALL TURN '¼ TURN' CLOCKWISE ON TO OFF POSITION (TYPICAL).
4. CURB BOXES SHALL BE PLACED A MINIMUM OF 20'-0 FROM ANY EXISTING OR PROPOSED FOUNDATION OR STRUCTURE.

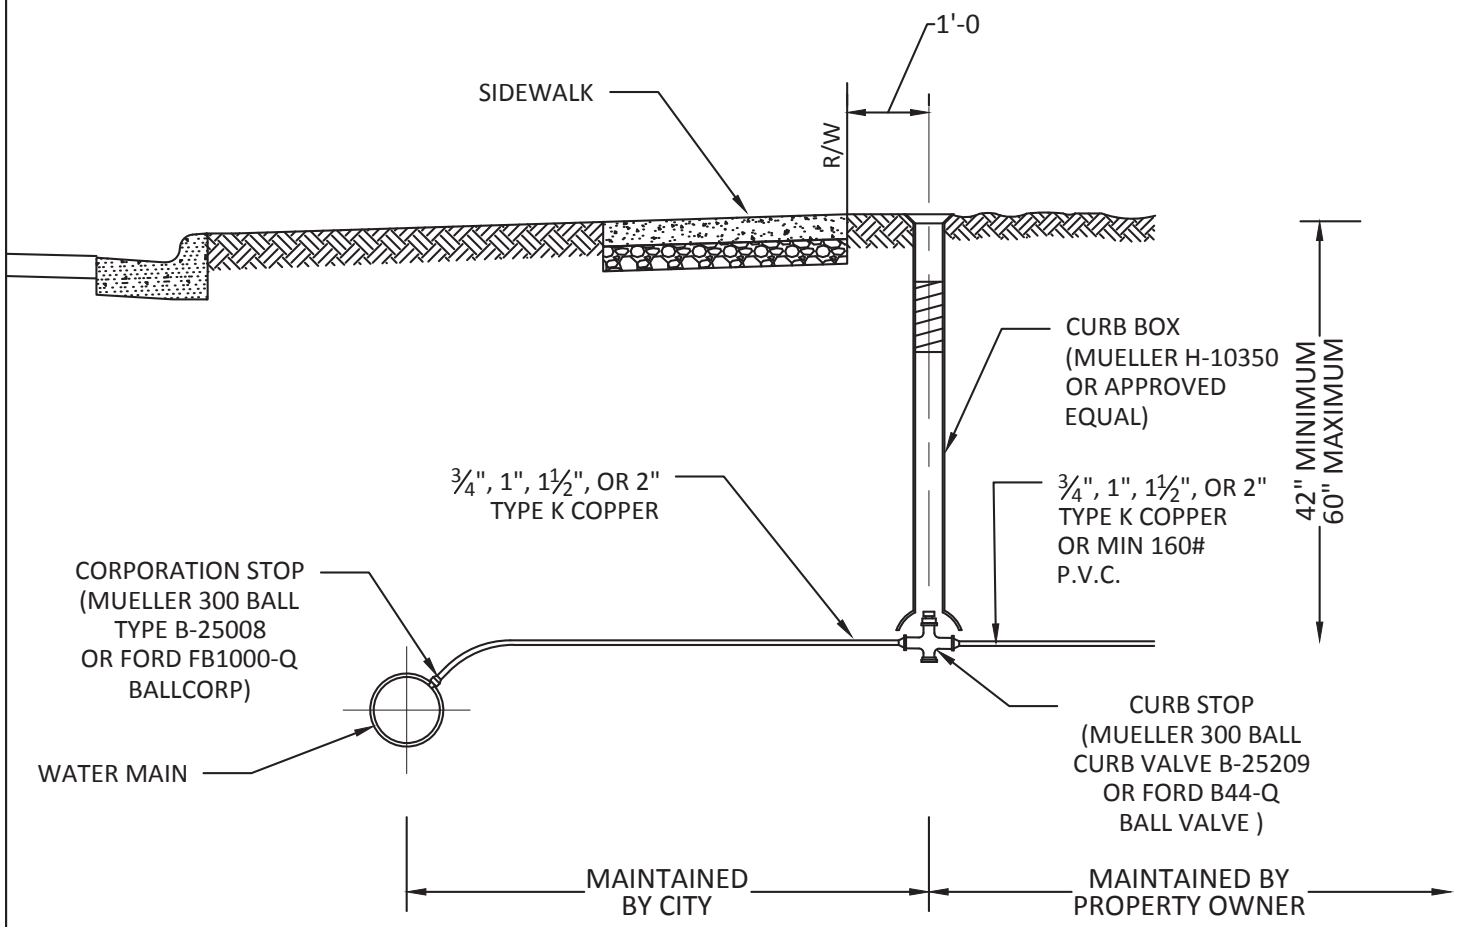


EST 1808
CITY OF
DELAWARE
OHIO
Public Works Department

STANDARD DETAIL

# DOMESTIC WATER SERVICE PRIVATE WATER MAINS

WATER

WTRD-1.1

Rev. 12/31/2018