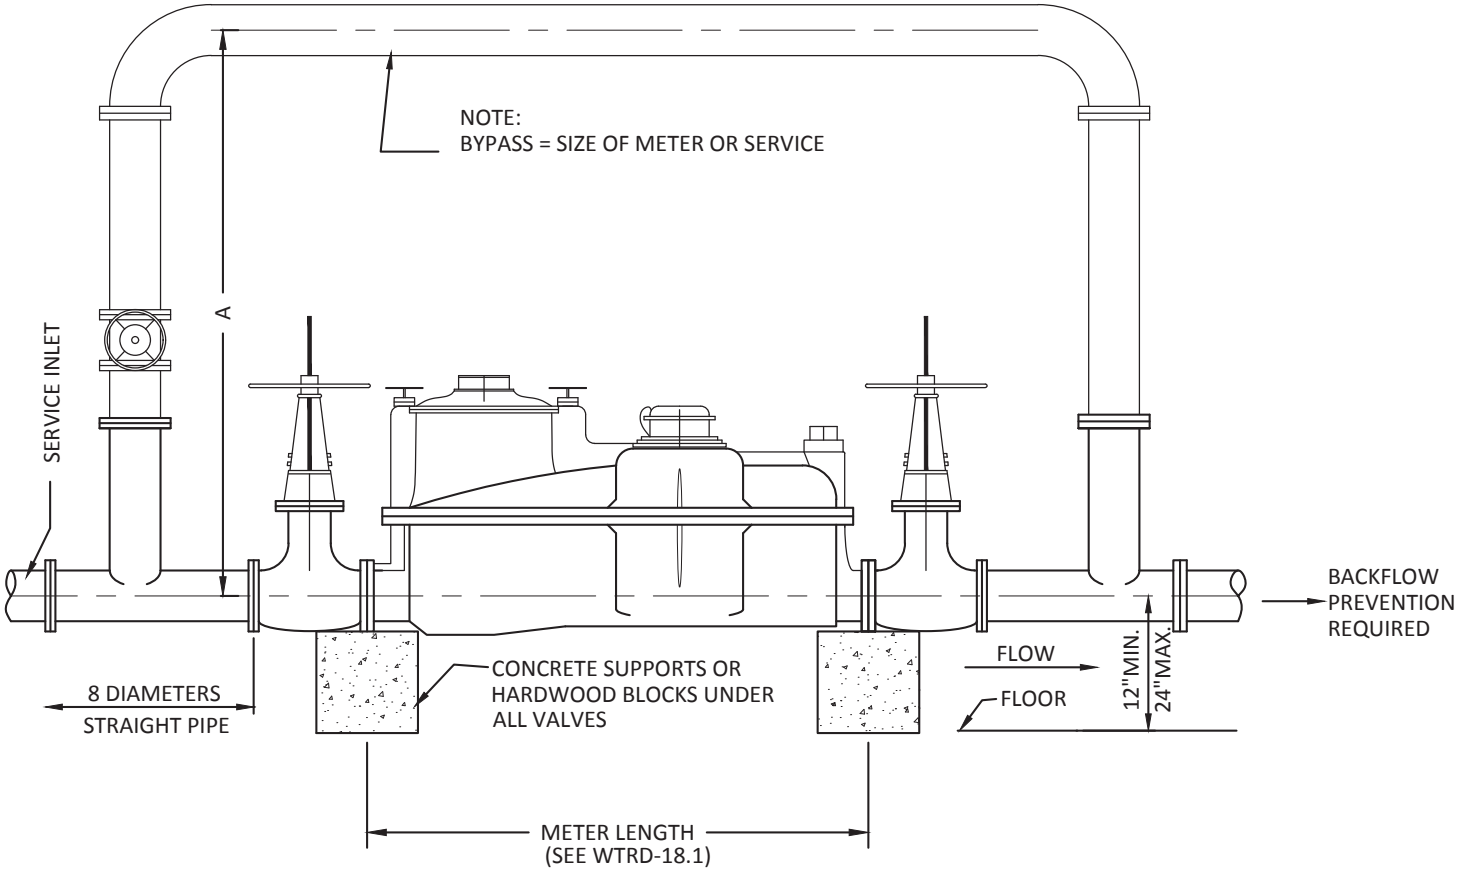


NOTES:

1. TEES AND BYPASS NOT REQUIRED FOR DCDA OR METERS LESS THAN 2"
2. BYPASS MUST BE INSTALLED IN VERTICAL POSITION
3. WALL CLEARANCE: THERE SHALL BE A MINIMUM SIDE CLEARANCE OF 24" FOR ALL METER TYPES AND SIZES FROM THE NEAREST PIPE EXTERIOR TO THE NEAREST BUILDING WALL AND/OR OBSTRUCTION. THIS MINIMUM SIDE CLEARANCE SHALL BE MAINTAINED FROM INLET VALVE TO OUTLET VALVE.
4. VALVING: 3" AND LARGER SHALL BE GATE VALVES WITH OUTSIDE STEMS AND YOKES (O.S.& Y.).

CLEARANCE REQUIRED "A"		
METER SIZE	CT	FMCT
3"	42"	48"
4"	45"	52"
6"	54"	60"
8"	N/A	70"
10"	N/A	78"
12"	N/A	86"

EST 1808
CITY OF
DELAWARE
OHIO
Public Works Department

STANDARD DETAIL

METER SETTING FOR INSIDE BUILDINGS

3" THROUGH 12" (DOMESTIC OR PROCESS)

WATER

WTRD-18.3

Rev. 12/31/2018