
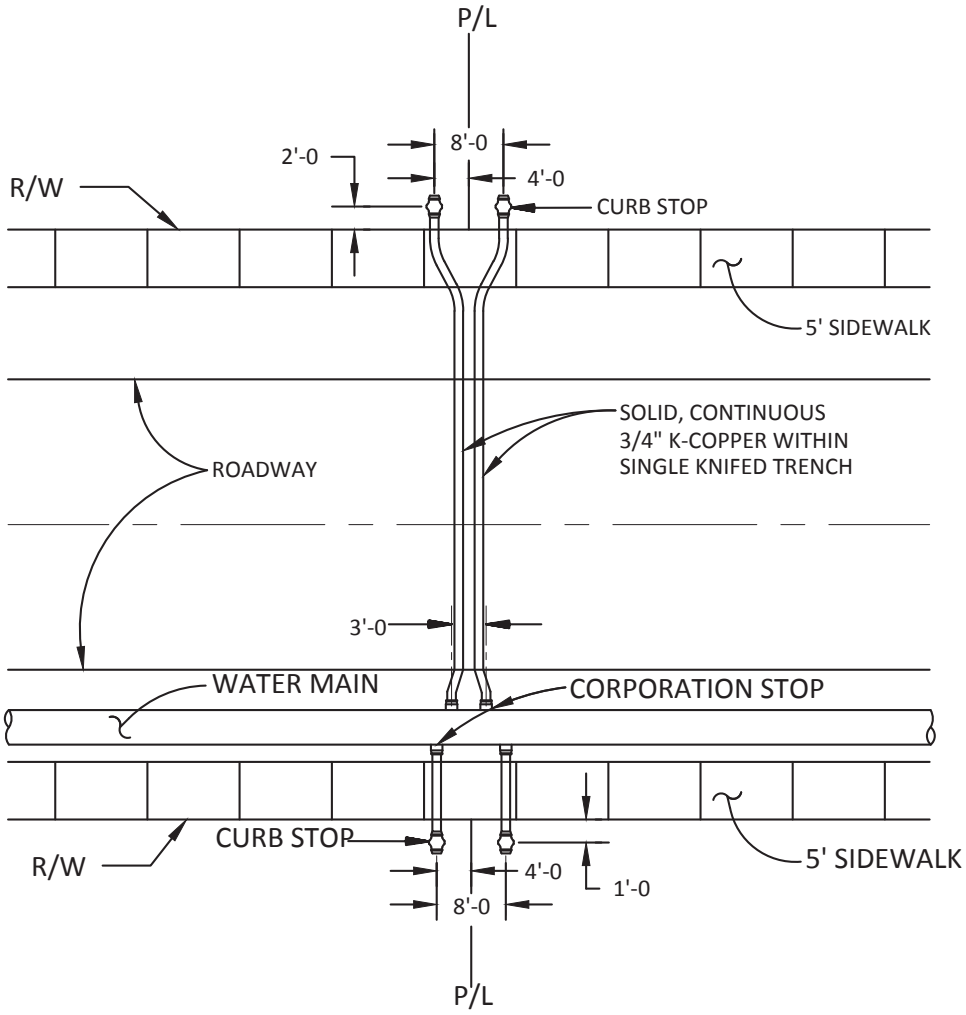


PLAN

NOT TO SCALE

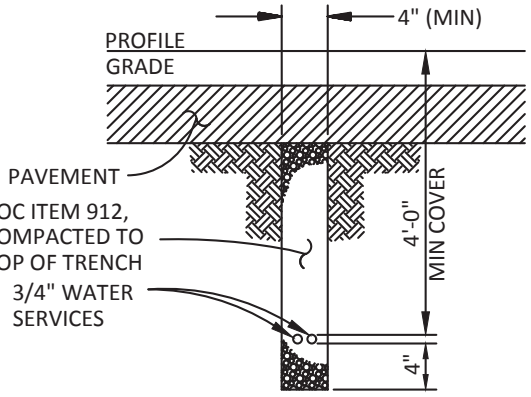

WATER SERVICE TRENCH DETAIL

NOT TO SCALE

NOTE:
MINIMUM DEPTH - 4'-0"
BELOW FINISHED GRADE

NO SPLICES PERMITTED
IN COPPER LINE BETWEEN
CORPORATION AND CURB
STOPS

EST 1808
CITY OF
DELAWARE
OHIO
Public Works Department

STANDARD DETAIL

WATER SERVICE STREET CROSSINGS
(2 SERVICES IN ONE TRENCH)

WATER

WTRD-4.0

Rev. 12/31/2018