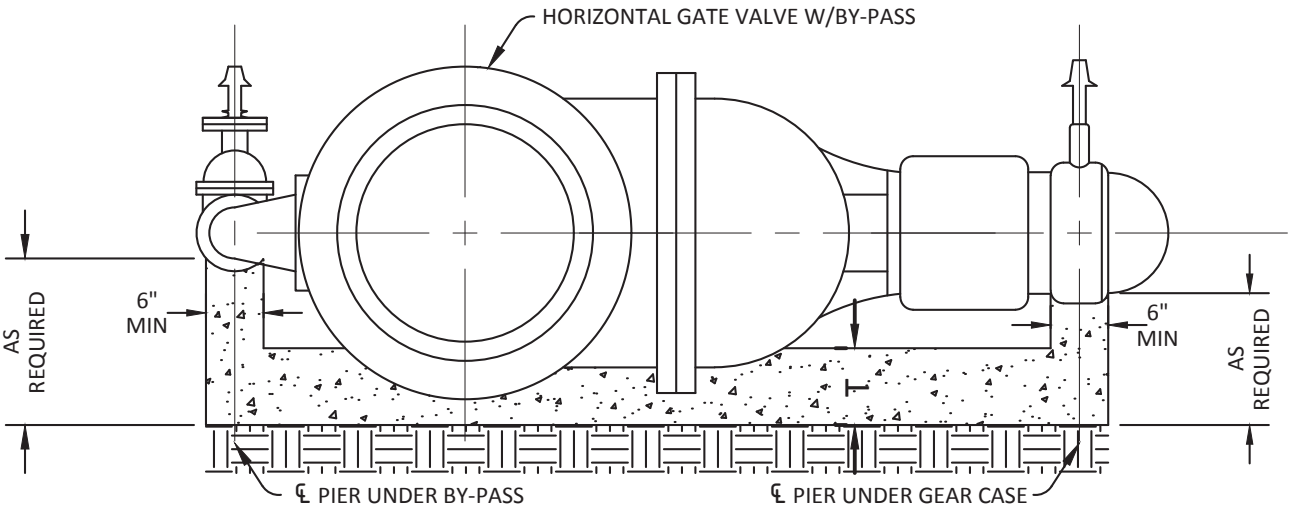


NOTES:

1. DIMENSIONS SHALL BE VARIED AS DIRECTED TO SUIT MAKE OF VALVE FURNISHED.
2. WIDTH SHALL BE AS REQUIRED TO ALLOW ACCESS TO BOLTS. (6" MIN.)
3. T = 6" MINIMUM
4. A LAYER OF POLYETHYLENE SHEETING REQUIRED BETWEEN CONCRETE AND WATERLINE, VALVES, ETC

EST 1808
CITY OF
DELAWARE
OHIO
Public Works Department

STANDARD DETAIL

CONCRETE VALVE SUPPORT

HORIZONTAL GATE VALVER W/BY-PASS

WATER

WTRD-8.0

Rev. 12/31/2018