

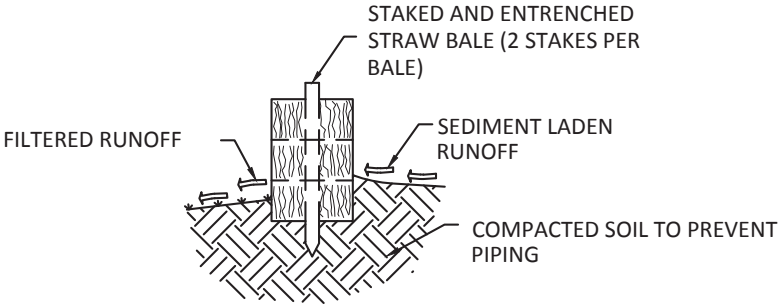


SECTION B-B

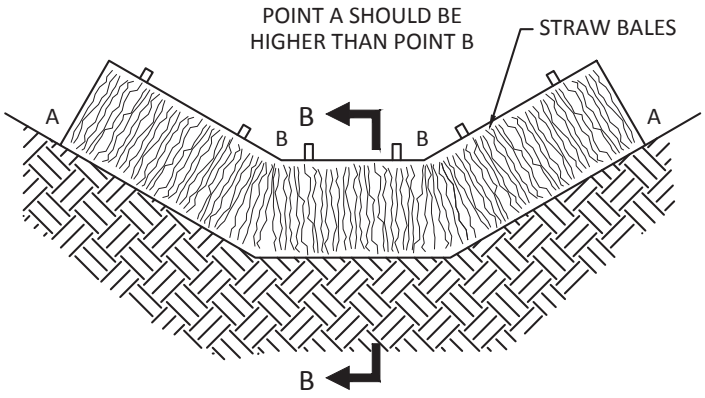

ELEVATION VIEW

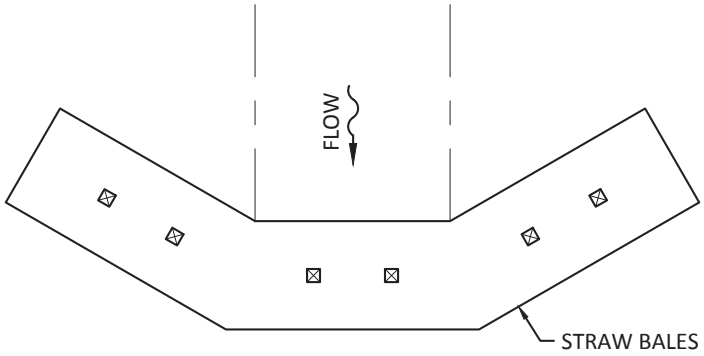

PLAN VIEW

SEDIMENT BARRIER IN DRAINAGE WAY

CONTRACTOR SHALL PLACE SEDIMENT BARRIERS AS LOCATED ON THIS SHEET IMMEDIATELY AFTER CONSTRUCTION OF DRAINAGE SWALES.

THE DITCH SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.

SEDIMENT SHALL BE REMOVED AND THE BALES RESTORED TO THEIR ORIGINAL DIMENSION WHEN THE SEDIMENT HAS ACCUMULATED TO HALF THE DESIGN DEPTH OF THE TRAP. SEDIMENT REMOVED SHALL BE DEPOSITED IN SUCH A MANNER THAT IT WILL NOT ERODE.

SEDIMENT FILTERS SHALL BE REMOVED WHEN ITS DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.

EST 1808 CITY OF DELAWARE OHIO Public Works Department	STANDARD DETAIL STRAW BALE DITCH CHECK	EROSION ERSD-6.0 Rev. 12/31/2018